

INSTALLATION INSTRUCTIONS


PART# 5086

INSTALLATION INSTRUCTIONS

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

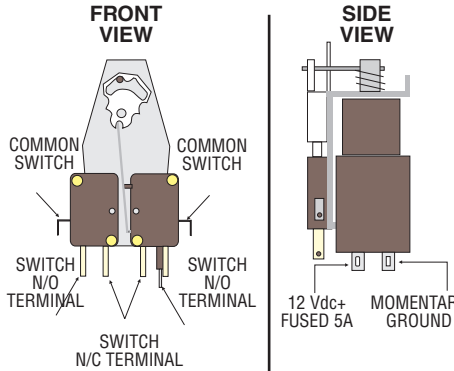

ACCELE ELECTRONICS, INC.


INSTALLATION INSTRUCTIONS

PART# 5086

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

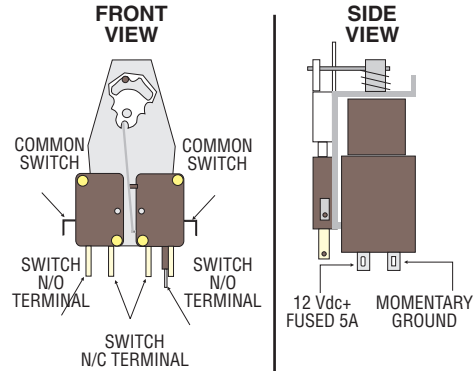

ACCELE ELECTRONICS, INC.


INSTALLATION INSTRUCTIONS

PART# 5086

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

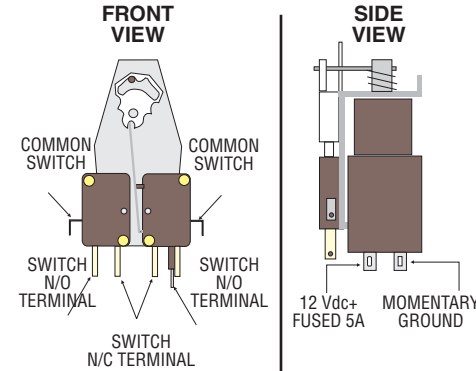

ACCELE ELECTRONICS, INC.


INSTALLATION INSTRUCTIONS

PART# 5086

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

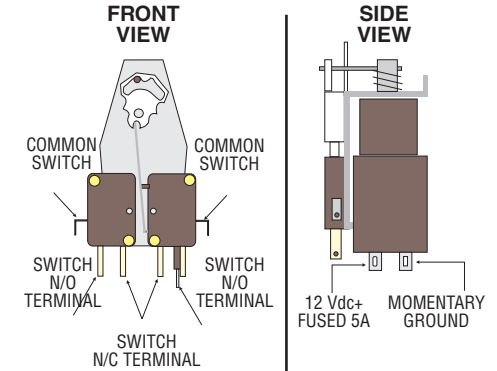

ACCELE ELECTRONICS, INC.

INSTALLATION INSTRUCTIONS


PART# 5086

INSTALLATION INSTRUCTIONS

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

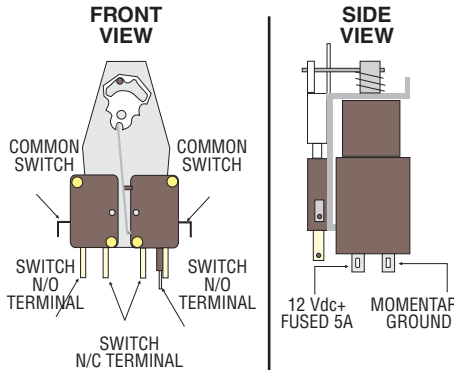

ACCELE ELECTRONICS, INC.


INSTALLATION INSTRUCTIONS

PART# 5086

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

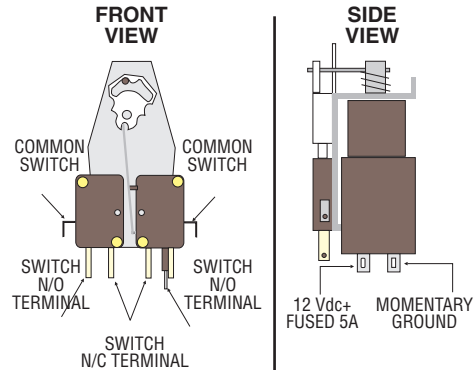

ACCELE ELECTRONICS, INC.


INSTALLATION INSTRUCTIONS

PART# 5086

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

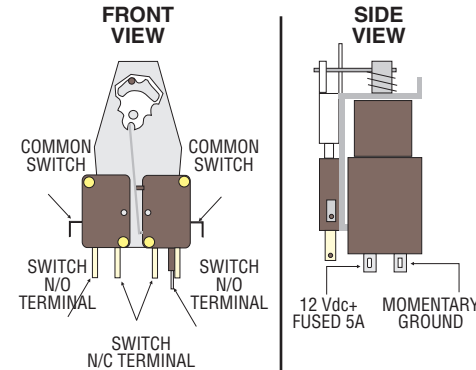

ACCELE ELECTRONICS, INC.


INSTALLATION INSTRUCTIONS

PART# 5086

LATCHING RELAY

The AE 5086 is basically a solenoid operated by 2 SPDT switches. The switch will change position each time the solenoid is activated.

By connecting one terminal of the solenoid to 12Vdc+ and sending a momentary ground to the other terminal, the solenoid will activate and mechanically operate the switches, first closing one set of contacts and then the other. The contacts are rated at 15A.

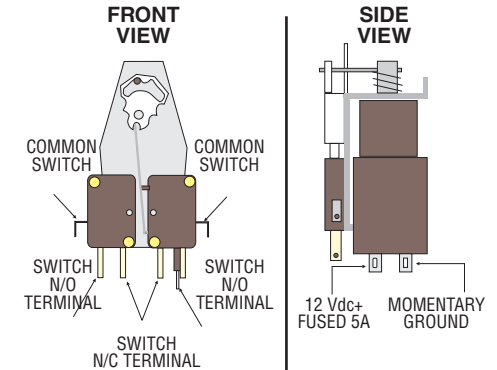

ACCELE ELECTRONICS, INC.